
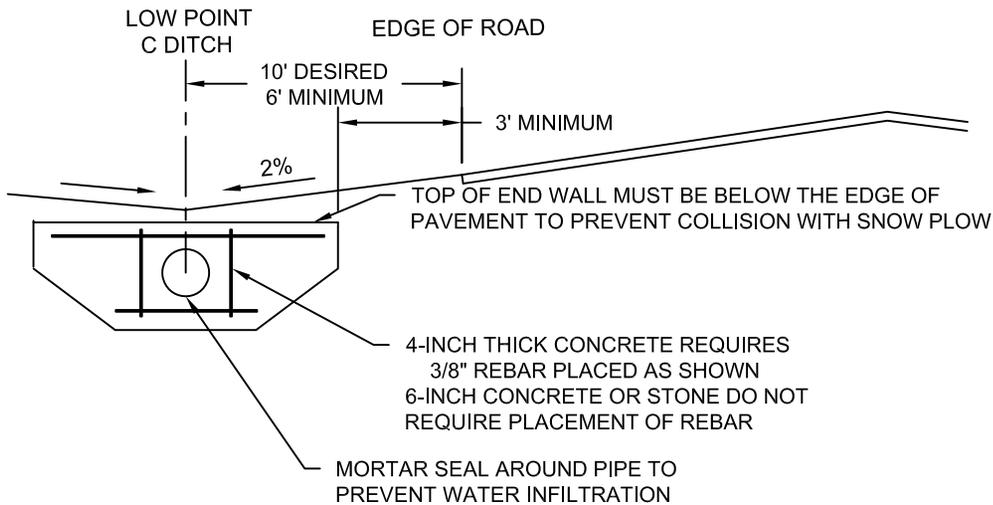


6" MIN CONCRETE FOR PIPE DIA  $\geq$  24-INCH  
 4" MIN CONCRETE FOR PIPE DIA  $<$  24-INCH  
 6" MIN MORTARED STONE

- MASONRY ENDWALLS ARE REQUIRED AND SHALL BE POURED OR PRE-CAST CONCRETE, MORTARED STONE, OR OTHER MASONRY MATERIAL.
- CONSTRUCTED AESTHETICALLY CONSISTENT WITH CITY STANDARDS EXTENDING THROUGH THE ENTIRE CROSS SECTION OF THE DITCH TO PREVENT WATER INFILTRATION AROUND THE CULVERT.
- PIPE SHALL EXTEND 2 INCHES BEYOND FACE OF ENDWALL.

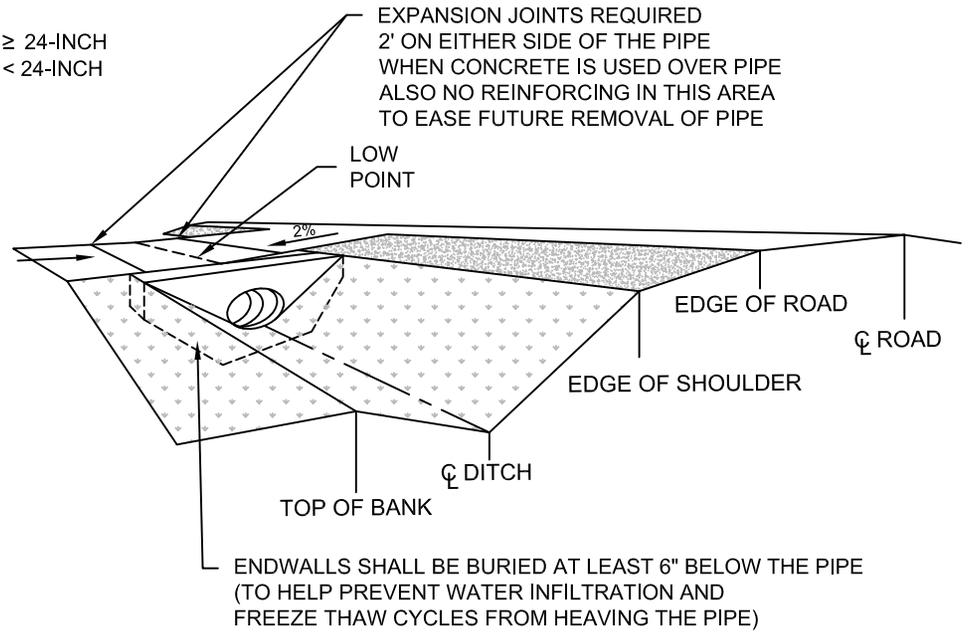

<b>FIGURE NO. 11</b>		
<b>DRIVEWAY APPROACH CULVERT ENDWALLS</b>		
 <b>CITY OF NEW BERLIN ENGINEERING DEPARTMENT</b>		
<b>DRAWN BY:</b> NPS/NLH	<b>DATE:</b> 1/01, REV 11/18	<b>SCALE:</b> NTS